

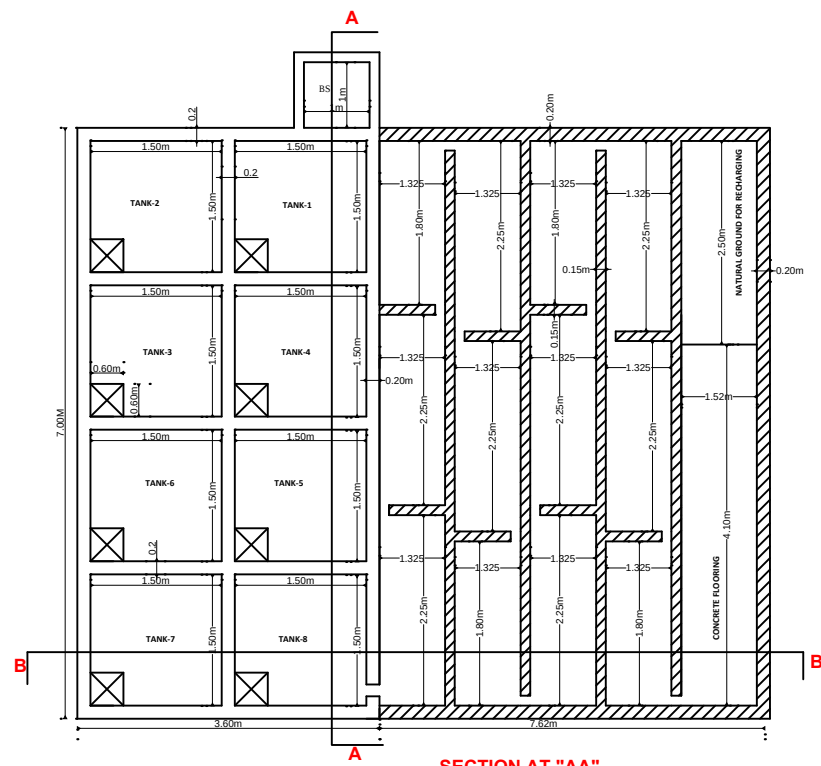


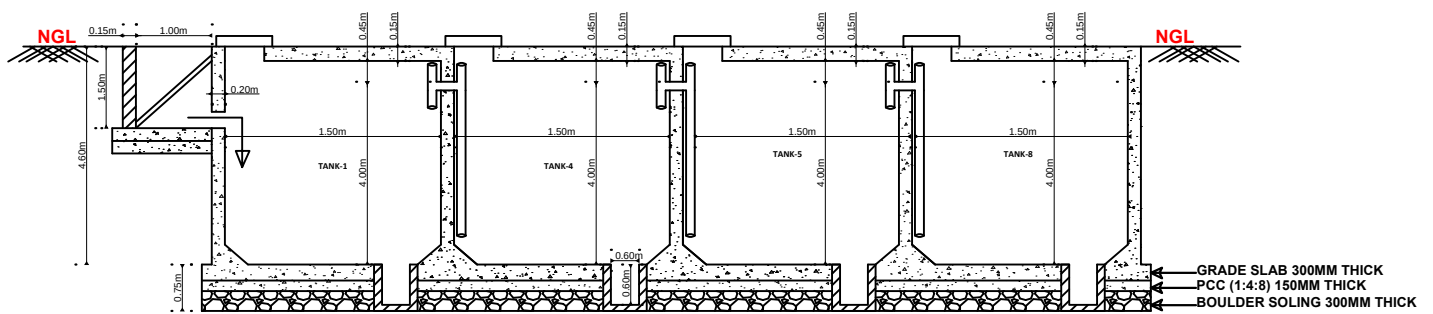


SECTION AT "AA"

IN CASE THE SEWAGE OUTFALL IS 2.00M BELOW THE GROUND LEVEL WET WELL SHOULD BE PROVIDED

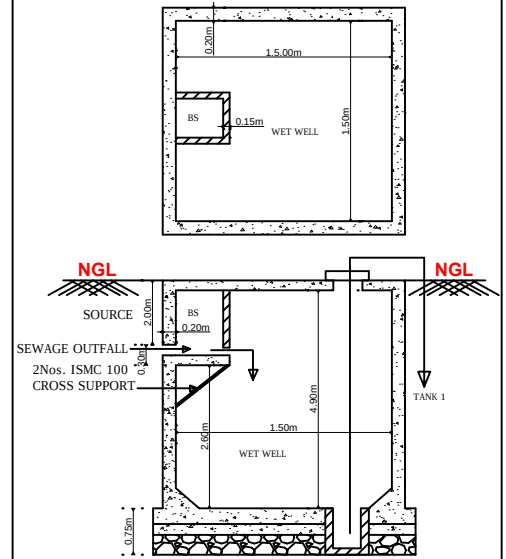

SECTION AT "AA"

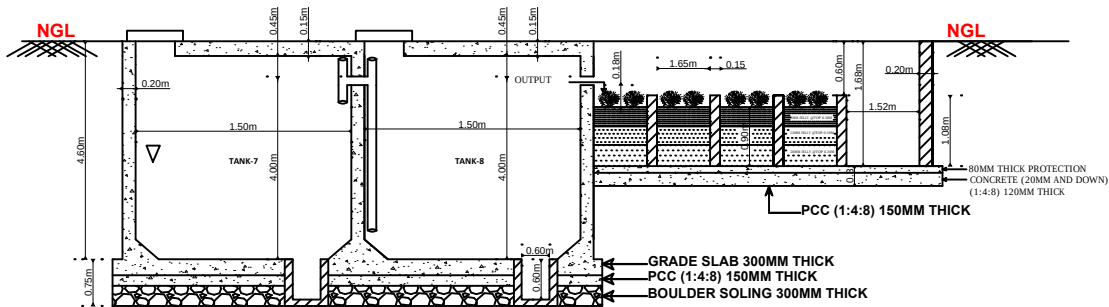

SECTION AT "BB"

KUWSDB

- 1). STP Drawing
- 2). STP Type : Natural Endogenous Bio Reactor
- 3). Treatment Method : Bio Chemical Oxidation
- 4). STP Capacity : 20 KLD
- 5). Phytored matheds
- 6). For 30 houses only.

TANKS	SIZE IN METER			
SL/NO	L	B	D	QTY/CUM
1	1.50	1.50	4.00	9.00
2	1.50	1.50	4.00	9.00
3	1.50	1.50	4.00	9.00
4	1.50	1.50	4.00	9.00
5	1.50	1.50	4.00	9.00
6	1.50	1.50	4.00	9.00
7	1.50	1.50	4.00	9.00
8	1.50	1.50	4.00	9.00
BS	1.00	1.00	1.50	1.50
WET WELL	1.50	1.50	2.60	5.85

Prithvi Eco sciences private ltd,
Mysuru Ph no:9845201959,
web :www.homestp.com/
www.prithvieco.com

NOTE:

SCALE : NOTE SCALE
REFER WRITTEN MEASUREMENTS ONLY