

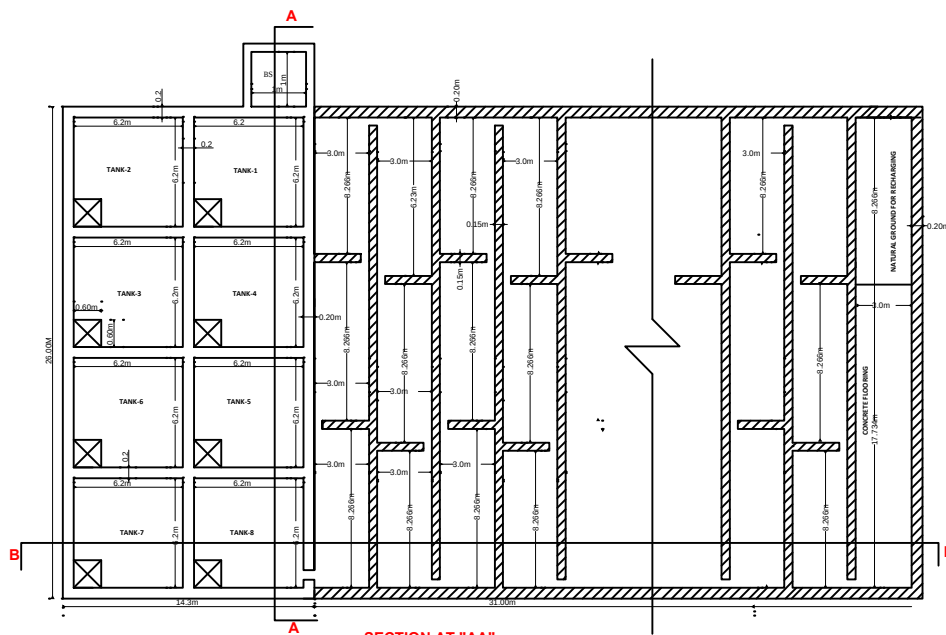


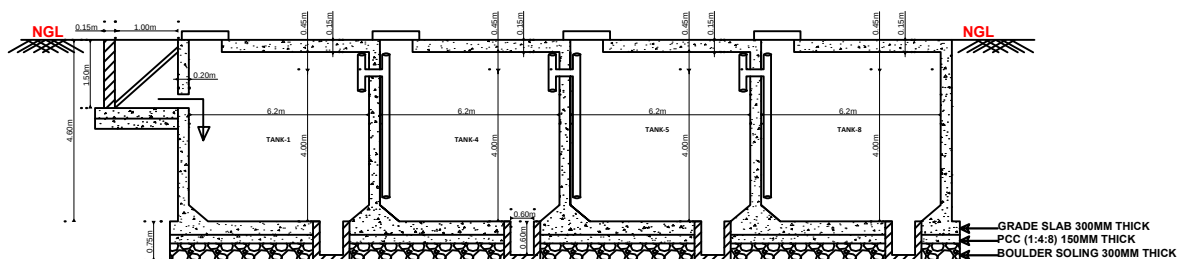


SECTION AT "AA"

IN CASE THE SEWAGE OUTFALL IS 2.00M BELOW THE GROUND LEVEL WET WELL SHOULD BE PROVIDED

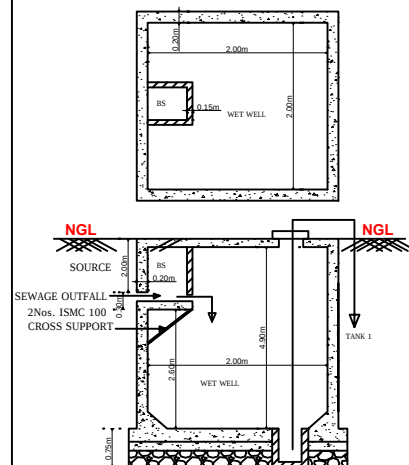

SECTION AT "AA"

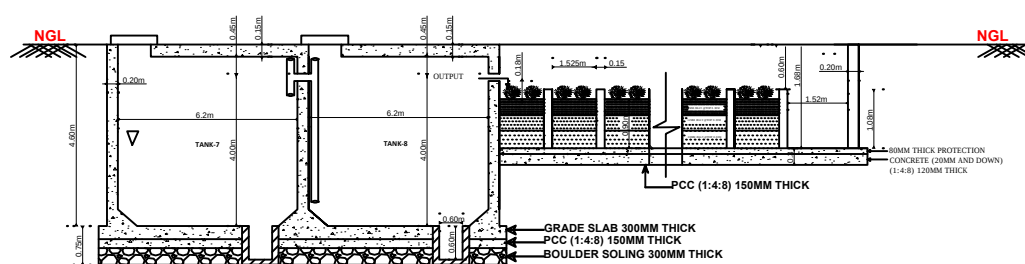

SECTION AT "BB"

KUWSDB

- 1). STP Drawing
- 2). STP Type : Natural Endogenous Bio Reactor
- 3). Treatment Method : Bio Chemical Oxidation
- 4). STP Capacity : 400 KLD
- 5). Phytored matheds
- 6). For 668 houses only.

TANKS	SIZE IN METER			QTY/CUM
	SL/NO	L	B	
	1	6.266	6.266	4.00
	2	6.266	6.266	4.00
	3	6.266	6.266	4.00
	4	6.266	6.266	4.00
	5	6.266	6.266	4.00
	6	6.266	6.266	4.00
	7	6.266	6.266	4.00
	8	6.266	6.266	4.00
	BS	1.00	1.00	1.50
	WET WELL	2.00	2.00	2.60

Prithvi Eco sciences private ltd,
Mysuru Ph no:9845201959,
web : www.homestp.com/
www.prithvieco.com

NOTE:

SCALE : NOTE SCALE
REFER WRITTEN MEASUREMENTS ONLY