

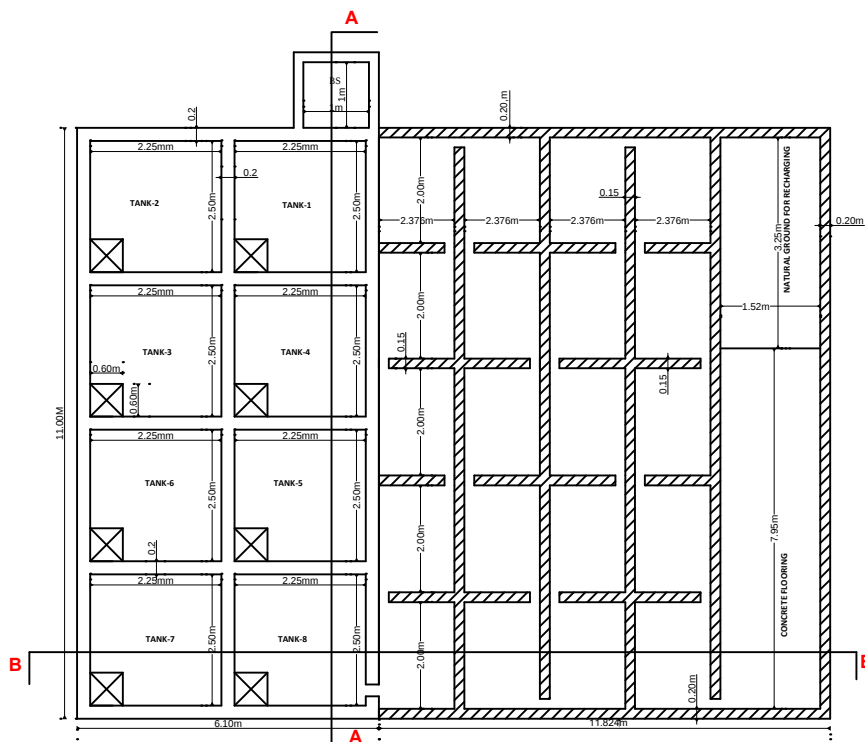


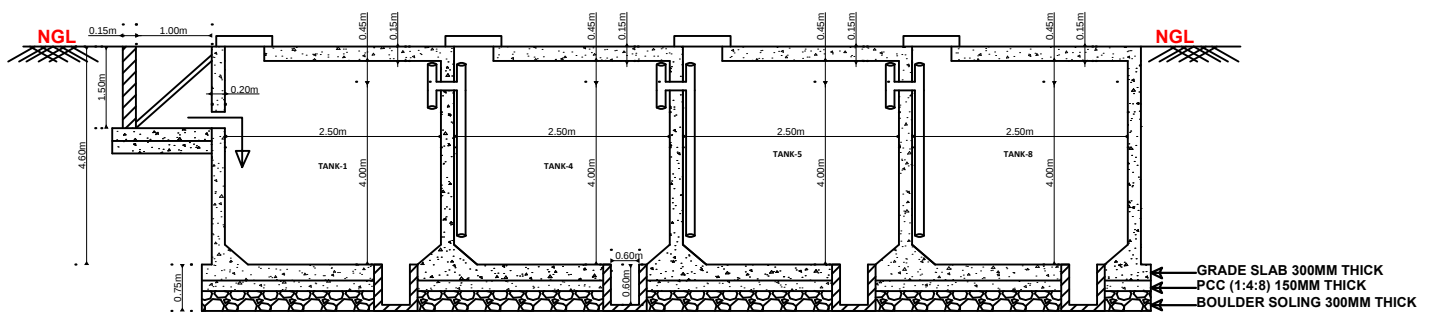


SECTION AT "AA"

IN CASE THE SEWAGE OUTFALL IS 2.00M BELOW THE GROUND LEVEL WET WELL SHOULD BE PROVIDED

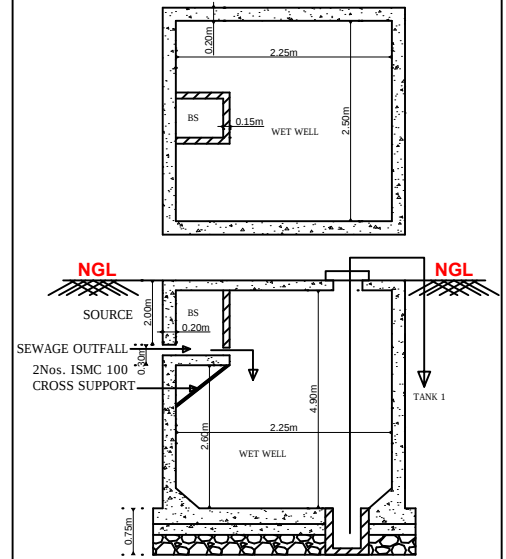

SECTION AT "AA"

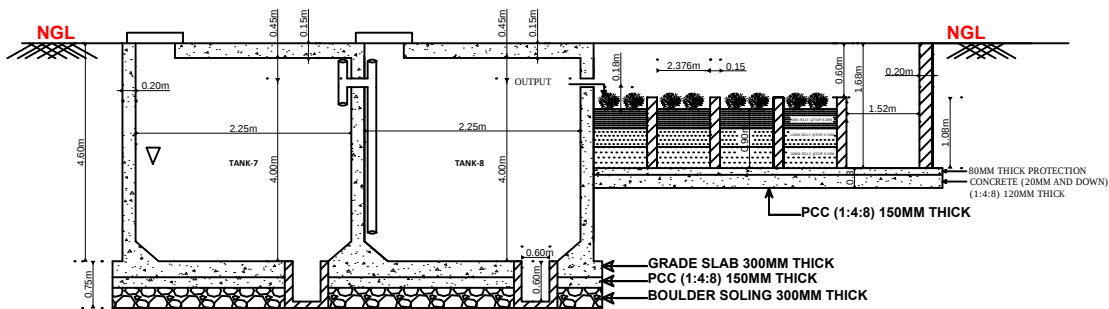

SECTION AT "BB"

KUWSDB

- 1). STP Drawing
- 2). STP Type : Natural Endogenous Bio Reactor
- 3). Treatment Method : Bio Chemical Oxidation
- 4). STP Capacity : 60 KLD
- 5). Phytored matheds
- 6). For 90 houses only.

TANKS	SIZE IN METER			
SL/NO	L	B	D	QTY/CUM
1	2.25	2.50	4.00	22.50
2	2.25	2.50	4.00	22.50
3	2.25	2.50	4.00	22.50
4	2.25	2.50	4.00	22.50
5	2.25	2.50	4.00	22.50
6	2.25	2.50	4.00	22.50
7	2.25	2.50	4.00	22.50
8	2.25	2.50	4.00	22.50
BS	1.00	1.00	1.50	01.50
WET WELL	2.25	2.50	2.60	14.625

Prithvi Eco sciences private ltd,
Mysuru Ph no:9845201959,
web :www.homestp.com/
www.prithvieco.com

NOTE:

SCALE : NOTE SCALE
REFER WRITTEN MEASUREMENTS ONLY