

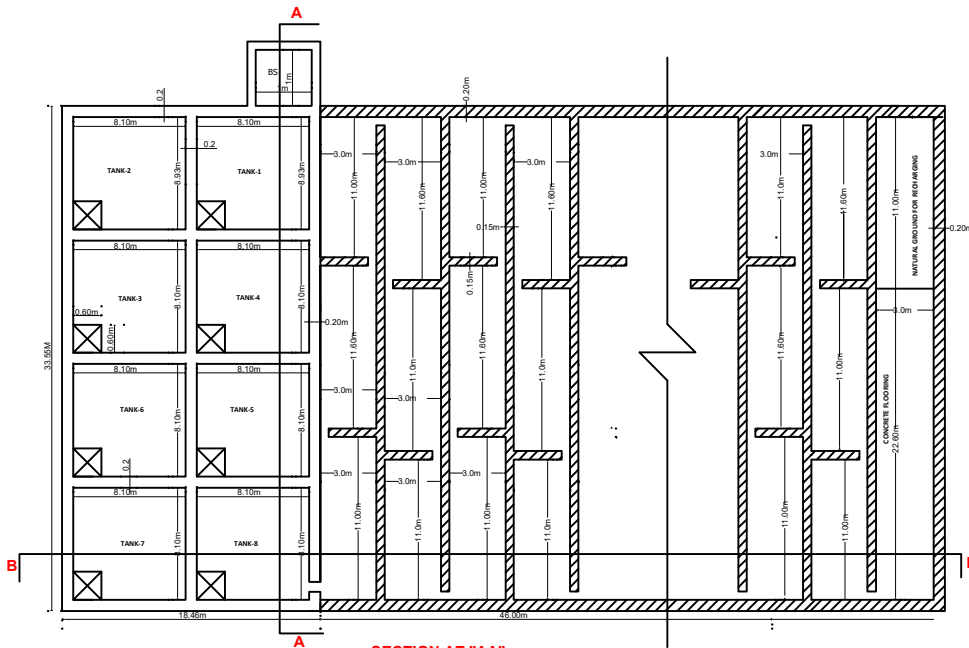


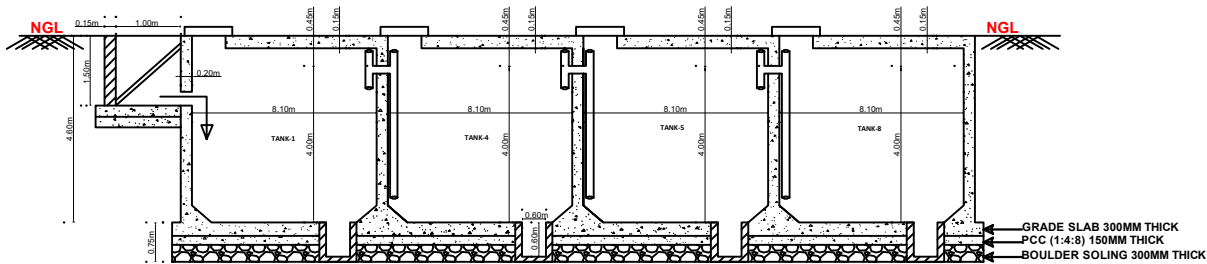


SECTION AT "AA"

IN CASE THE SEWAGE OUTFALL IS 2.00M BELOW THE GROUND LEVEL WET WELL SHOULD BE PROVIDED

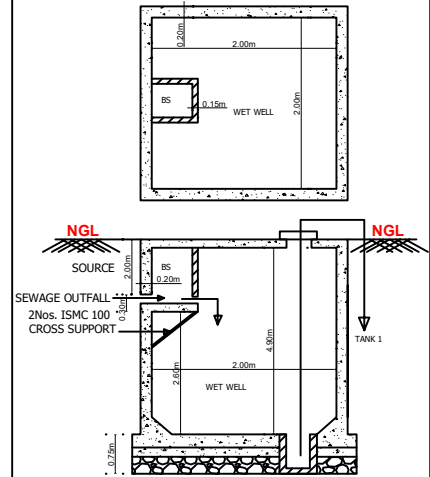

SECTION AT "AA"

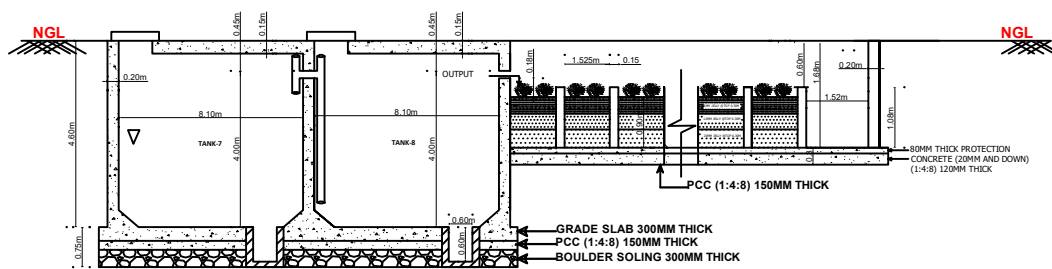

SECTION AT "BB"

KUWSDB

- 1). STP Drawing
- 2). STP Type : Natural Endogenous Bio Reactor
- 3). Treatment Method : Bio Chemical Oxidation
- 4). STP Capacity : 700 KLD
- 5). Phytoremediation
- 6). For 1000 houses only

TANKS	SIZE IN METER			QTY/CUM
SL/NO	L	B	D	
1	8.10	8.10	4.00	262.44
2	8.10	8.10	4.00	262.44
3	8.10	8.10	4.00	262.44
4	8.10	8.10	4.00	262.44
5	8.10	8.10	4.00	262.44
6	8.10	8.10	4.00	262.44
7	8.10	8.10	4.00	262.44
8	8.10	8.10	4.00	262.44
BS	1.00	1.00	1.50	01.50

Prithvi Eco sciences private ltd,
Mysuru Ph no:9845201959,
web :www.homestp.com/
www.prithvieco.com

NOTE:

SCALE : NOTE SCALE
REFER WRITTEN MEASUREMENTS ONLY