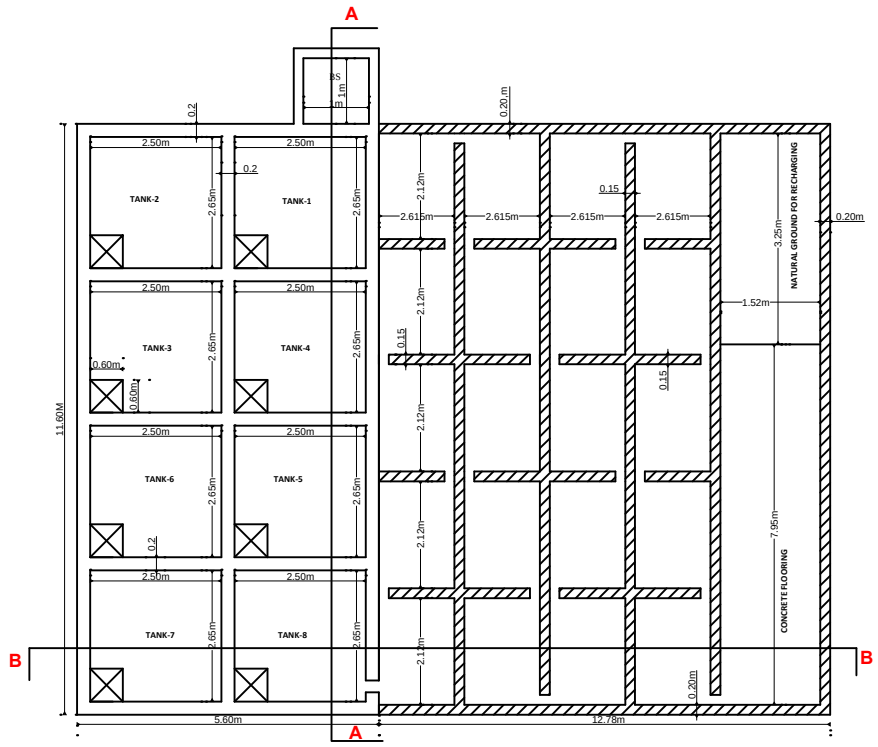

SECTION AT "AA"

IN CASE THE SEWAGE OUTFALL IS 2.00M BELOW THE GROUND LEVEL WET WELL SHOULD BE PROVIDED



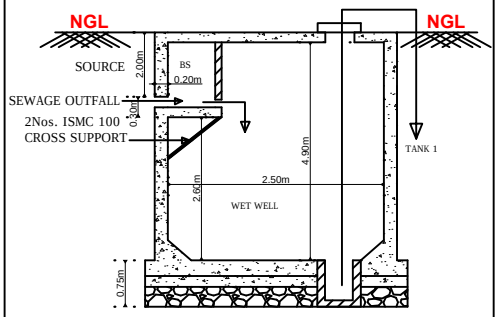

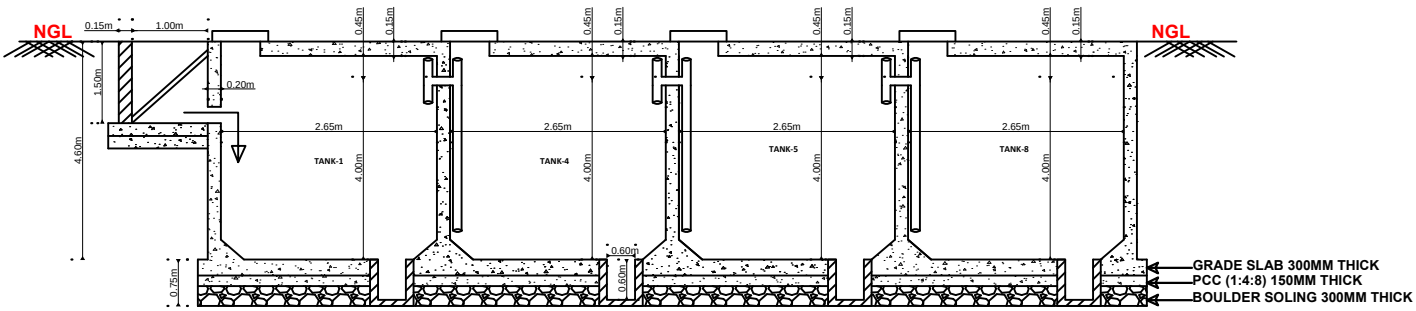

SECTION AT "AA"

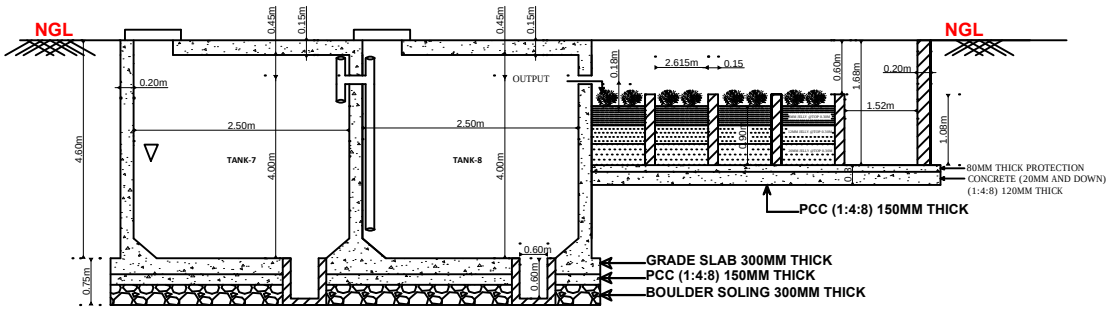

SECTION AT "BB"

KUWSDB

1). STP Drawing
2). STP Type : Natural Endogenous Bio Reactor
3). Treatment Method : Bio Chemical Oxidation
4). STP Capacity : 70 KLD
5). Phytored matheds
6). For 115 houses only.

TANKS	SIZE IN METER			
SL/NO	L	B	D	QTY/CUM
1	2.50	2.65	4.00	26.50
2	2.50	2.65	4.00	26.50
3	2.50	2.65	4.00	26.50
4	2.50	2.65	4.00	26.50
5	2.50	2.65	4.00	26.50
6	2.50	2.65	4.00	26.50
7	2.50	2.65	4.00	26.50
8	2.50	2.65	4.00	26.50
BS	1.00	1.00	1.50	01.50
WET WELL	2.50	2.65	2.60	17.225

Prithvi Eco sciences private ltd,
Mysuru Ph no:9845201959,
web :www.homestp.com/
www.prithvieco.com

NOTE:

SCALE : NOTE SCALE
REFER WRITTEN MEASUREMENTS ONLY