

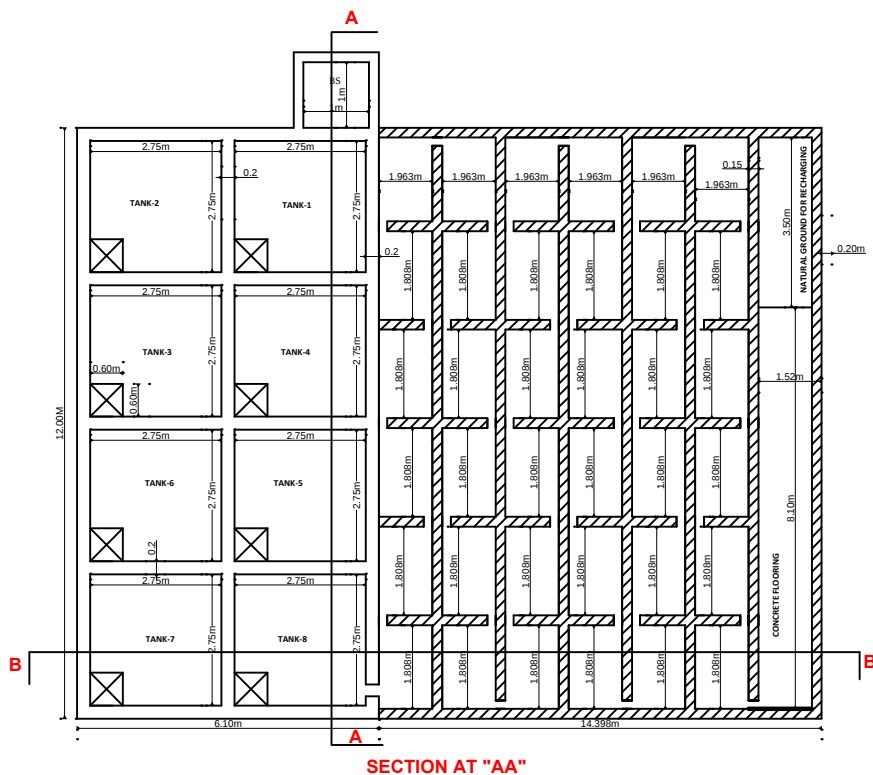
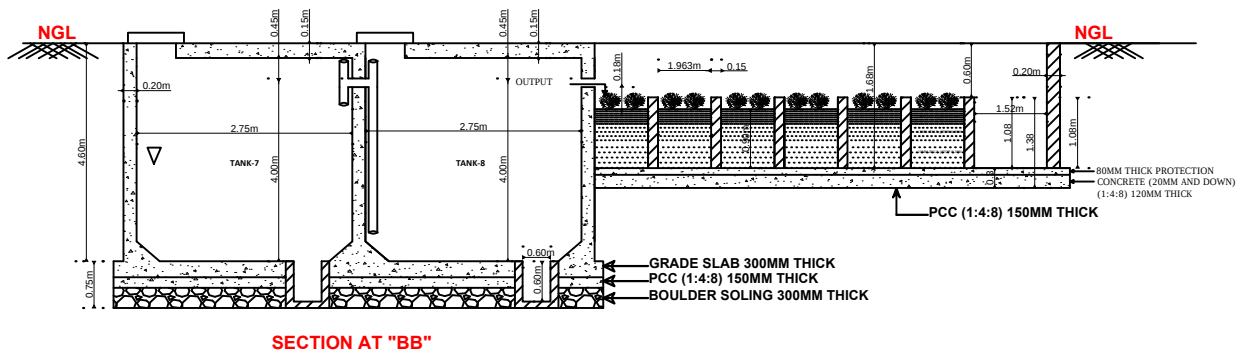


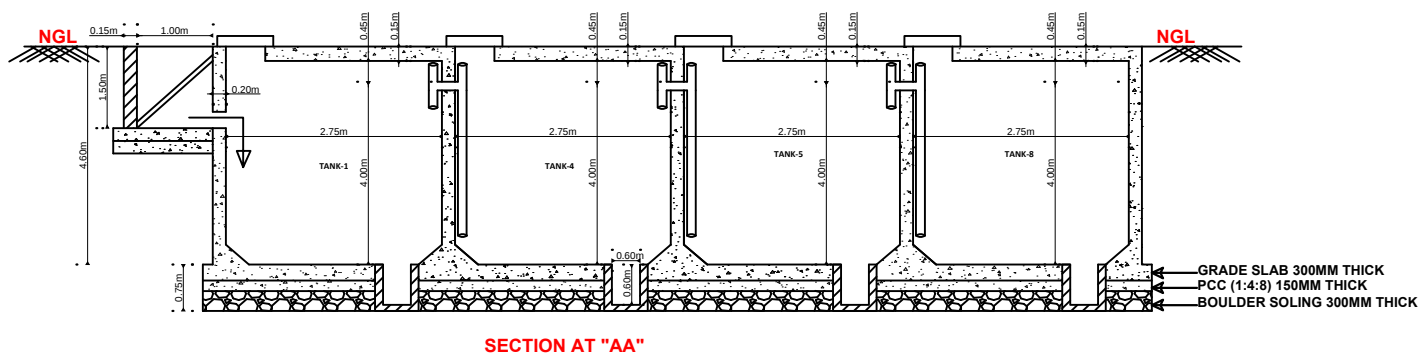

IN CASE THE SEWAGE OUTFALL IS 2.00M BELOW THE GROUND LEVEL WET WELL SHOULD BE PROVIDED

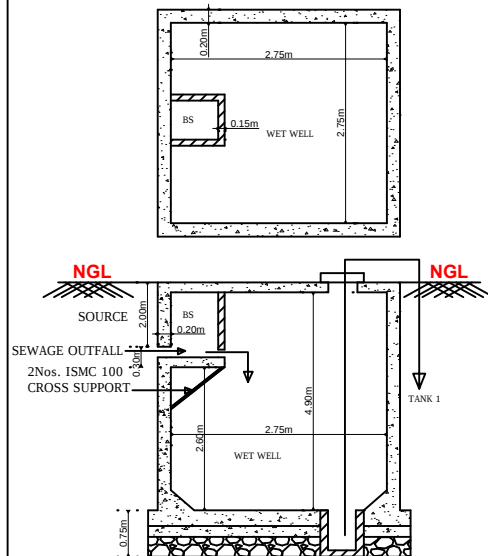

KUWSDB

- 1). STP Drawing
- 2). STP Type : Natural Endogenous Bio Reactor
- 3). Treatment Method : Bio Chemical Oxidation
- 4). STP Capacity : 80 KLD
- 5). Phytoremediation
- 6). For 130 houses only.

TANKS	SIZE IN METER			
SL/NO	L	B	D	QTY/CUM
1	2.75	2.75	4.00	30.25
2	2.75	2.75	4.00	30.25
3	2.75	2.75	4.00	30.25
4	2.75	2.75	4.00	30.25
5	2.75	2.75	4.00	30.25
6	2.75	2.75	4.00	30.25
7	2.75	2.75	4.00	30.25
8	2.75	2.75	4.00	30.25
BS	1.00	1.00	1.50	01.50
WET WELL	2.75	2.75	2.60	13.66

Prithvi Eco sciences private ltd,
Mysuru Ph no:9845201959,
web :www.homestp.com/
www.prithvieco.com

NOTE:

**SCALE : NOTE SCALE
REFER WRITTEN MEASUREMENTS ONLY**